

İMAJ TEKNİK
ELEKTRİK ELEKTRONİK MALZ. SAN. VE TİC. LTD. ŞTİ

EUCR



- Compact Design
- Two Integral Current Transformers
- Under-load Protection/Dry-run Protector
- Wide Current Adjustment Range
- Definite Trip Time Characteristic
- Manual(instantaneous)/Electrical(Remote)Reset
- Ambient Insensitive
- Non-Fail-safe Operation


Protection

Protective Item	Trip Time
Undercurrent(Dry-run)	O-TIME

Specification

Current Setting	Type		Range
	05		0.5 ~ 6A
	30		3.0 ~ 30A
	60		5.0 ~ 60A
100 ~ 600		0.5 Type fitted to Ext. CT (Current Ratio:100/5A-600/5A)	
Power Supply	Voltage	24	24VAC / DC
		110	110VAC
		220	220VAC
Frequency		50/60Hz	
Output Relay	Mode		1-SPDT(1C)
	Rating		3A / 250VAC Resistive
	Status		Normally DE-Energized
Trip Time Setting	O-TIME	0.2~30sec	
Reset		Manual(Instantaneous) / Electrical(Remote)	
Time-Current Characteristic		Definite	

Typical Wiring

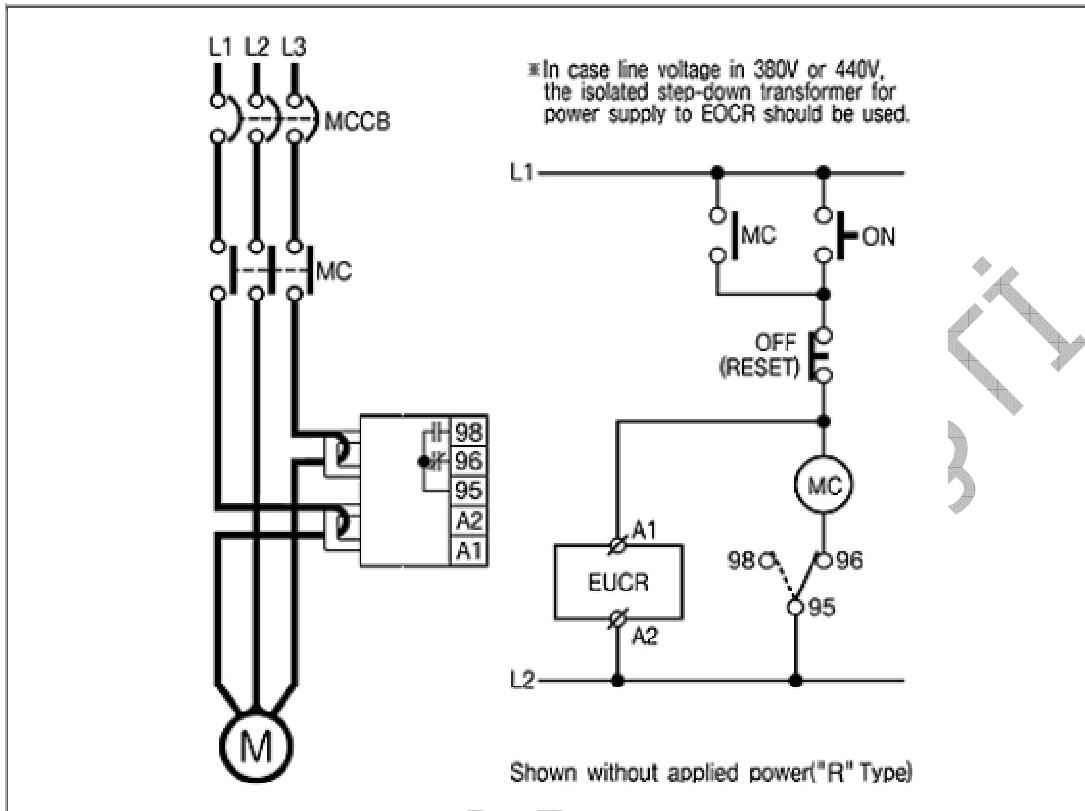

İMAJTEKNIK



İmaj Teknik Elektrik Elektronik San. ve Tic. Ltd. Şti.

EMEYEMEZ MAH.TUTSAK SOK. NO: 16/13-14-15
 KARAKOY/İSTANBUL
 TURKEY

Telefon : +90 212 235 9535 / 36
 Fax : +90 212 235 9537

www.imajteknik.com
 www.imajteknik.com.tr